
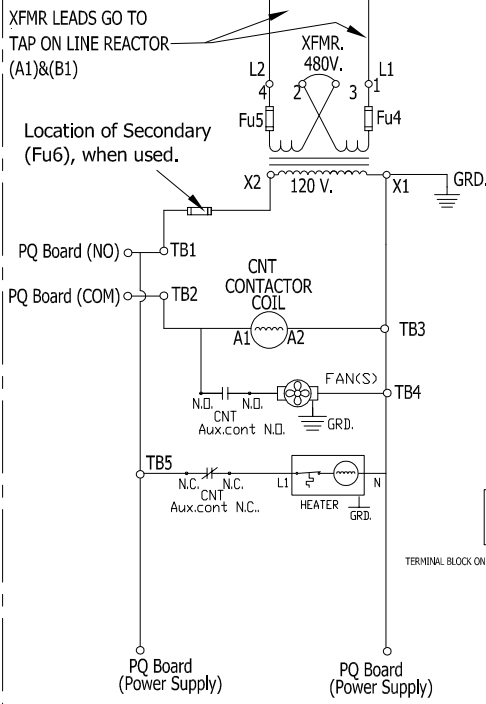


CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

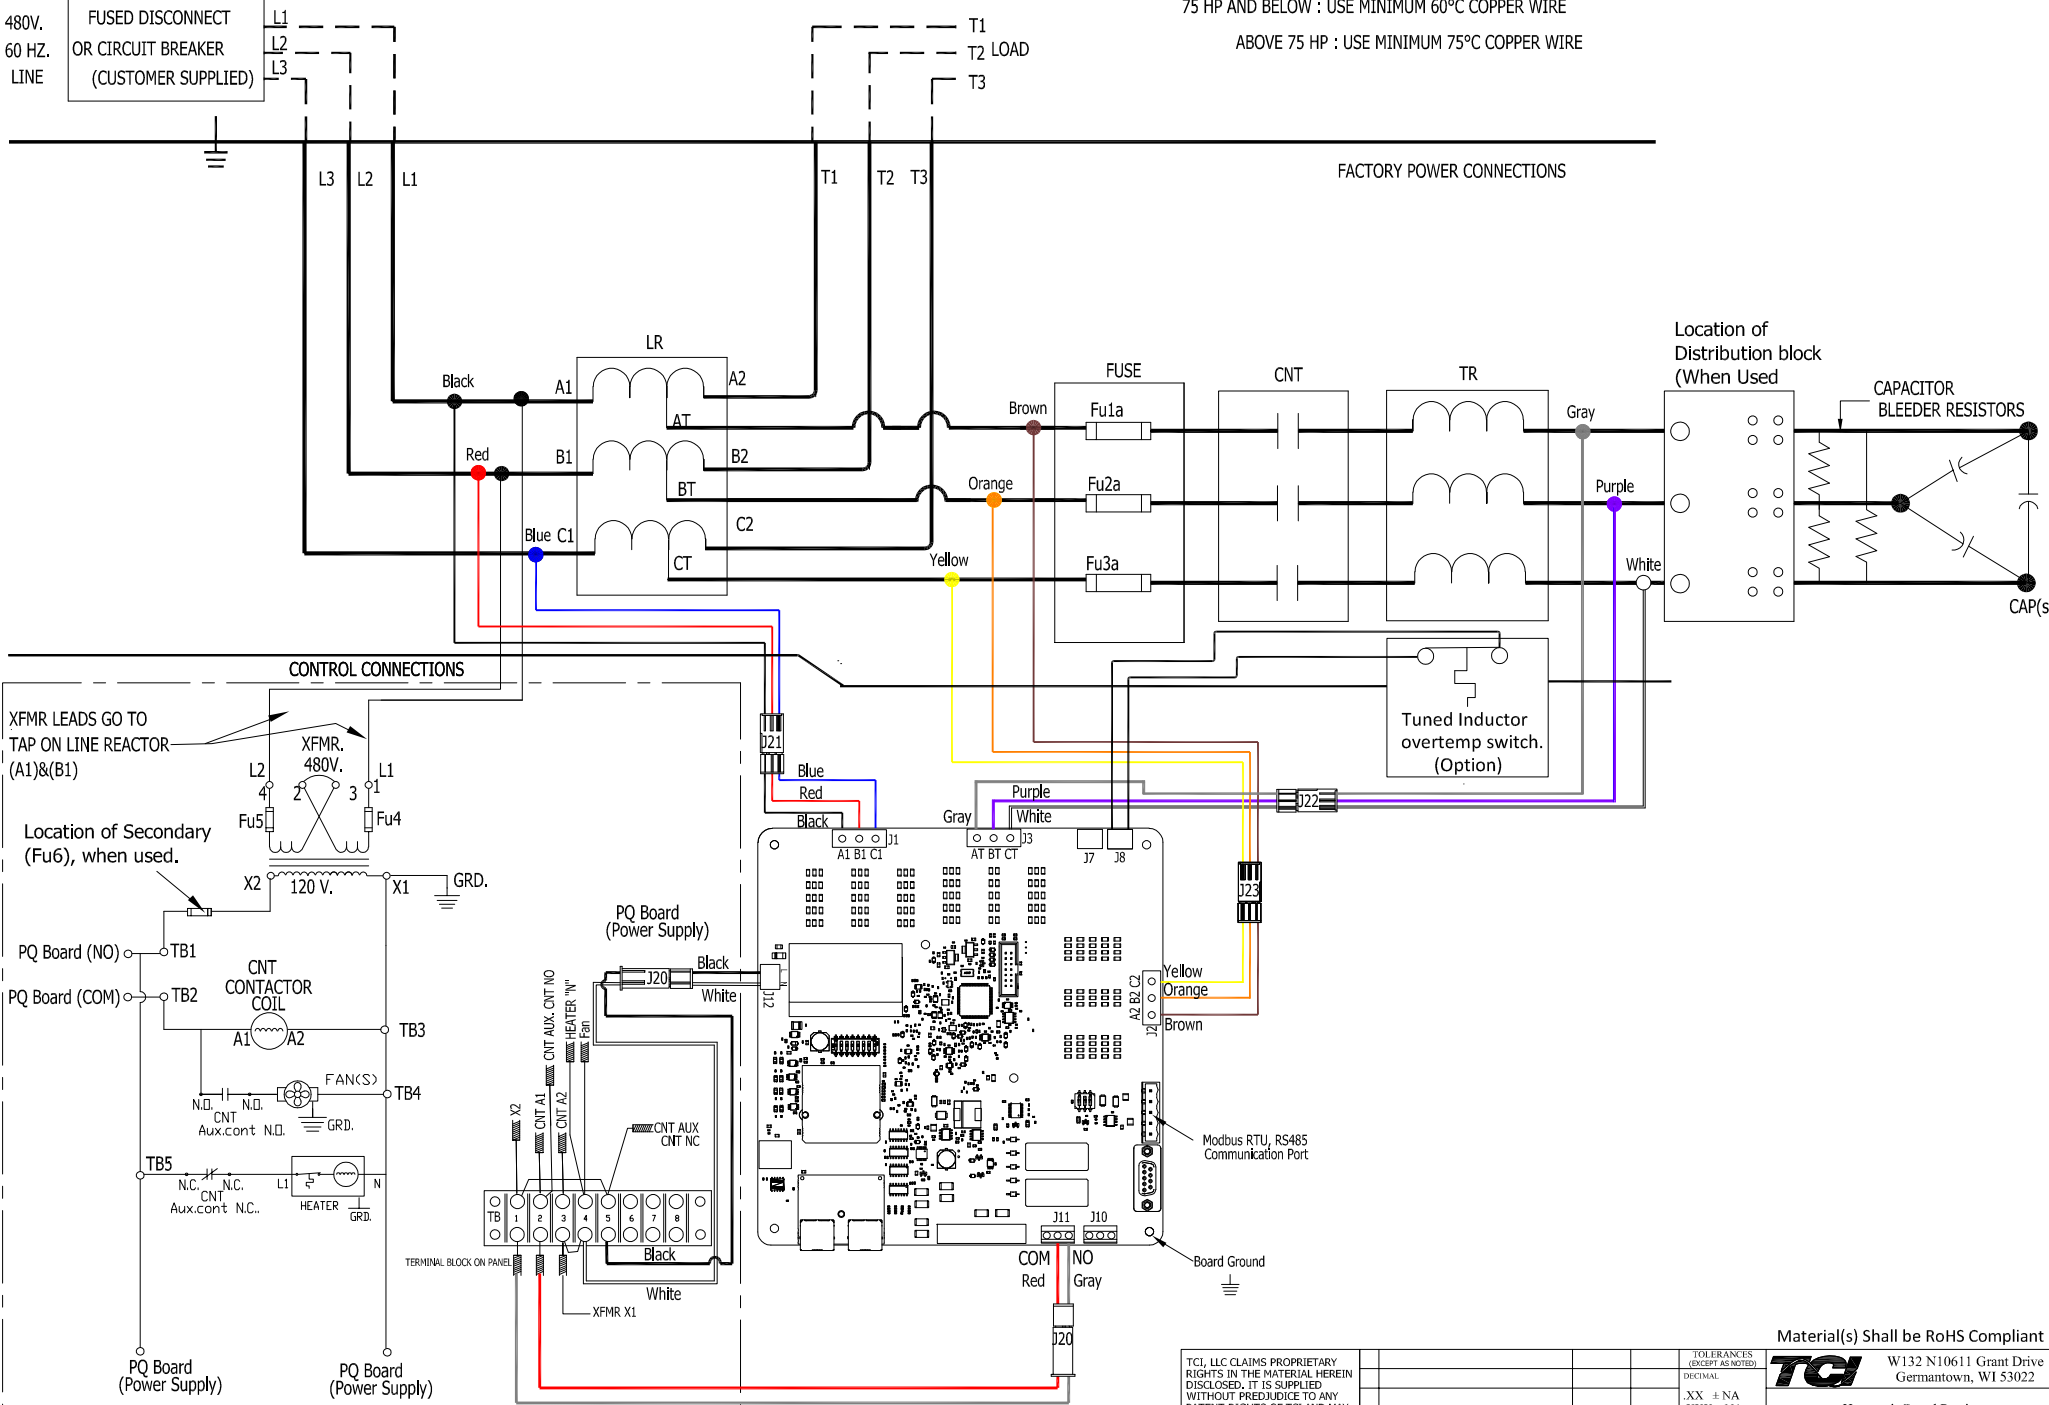

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED, IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± NA .XXX ± NA			
A Used when 1kVA control transformer and 800 W heater.				FRAC TIONAL NA			
NO REVISION				ANGULAR NA			
DATE BY				DATE BY			
11/18/20 DW				11/18/20 DW			
DATE BY				DATE BY			
DATE BY				DATE BY			

Material(s) Shall be RoHS Compliant

TCL W132 N10611 Grant Drive
 Germantown, WI 53022

HarmonicGuard Passive
 480V Contactor/PQconnect/800W Heater

REV. BY: DSW DATE: 11/18/20
 SCALE: NA APPRVD: 29597-PCH
 SIZE: C SHEET 1 OF 1