



CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

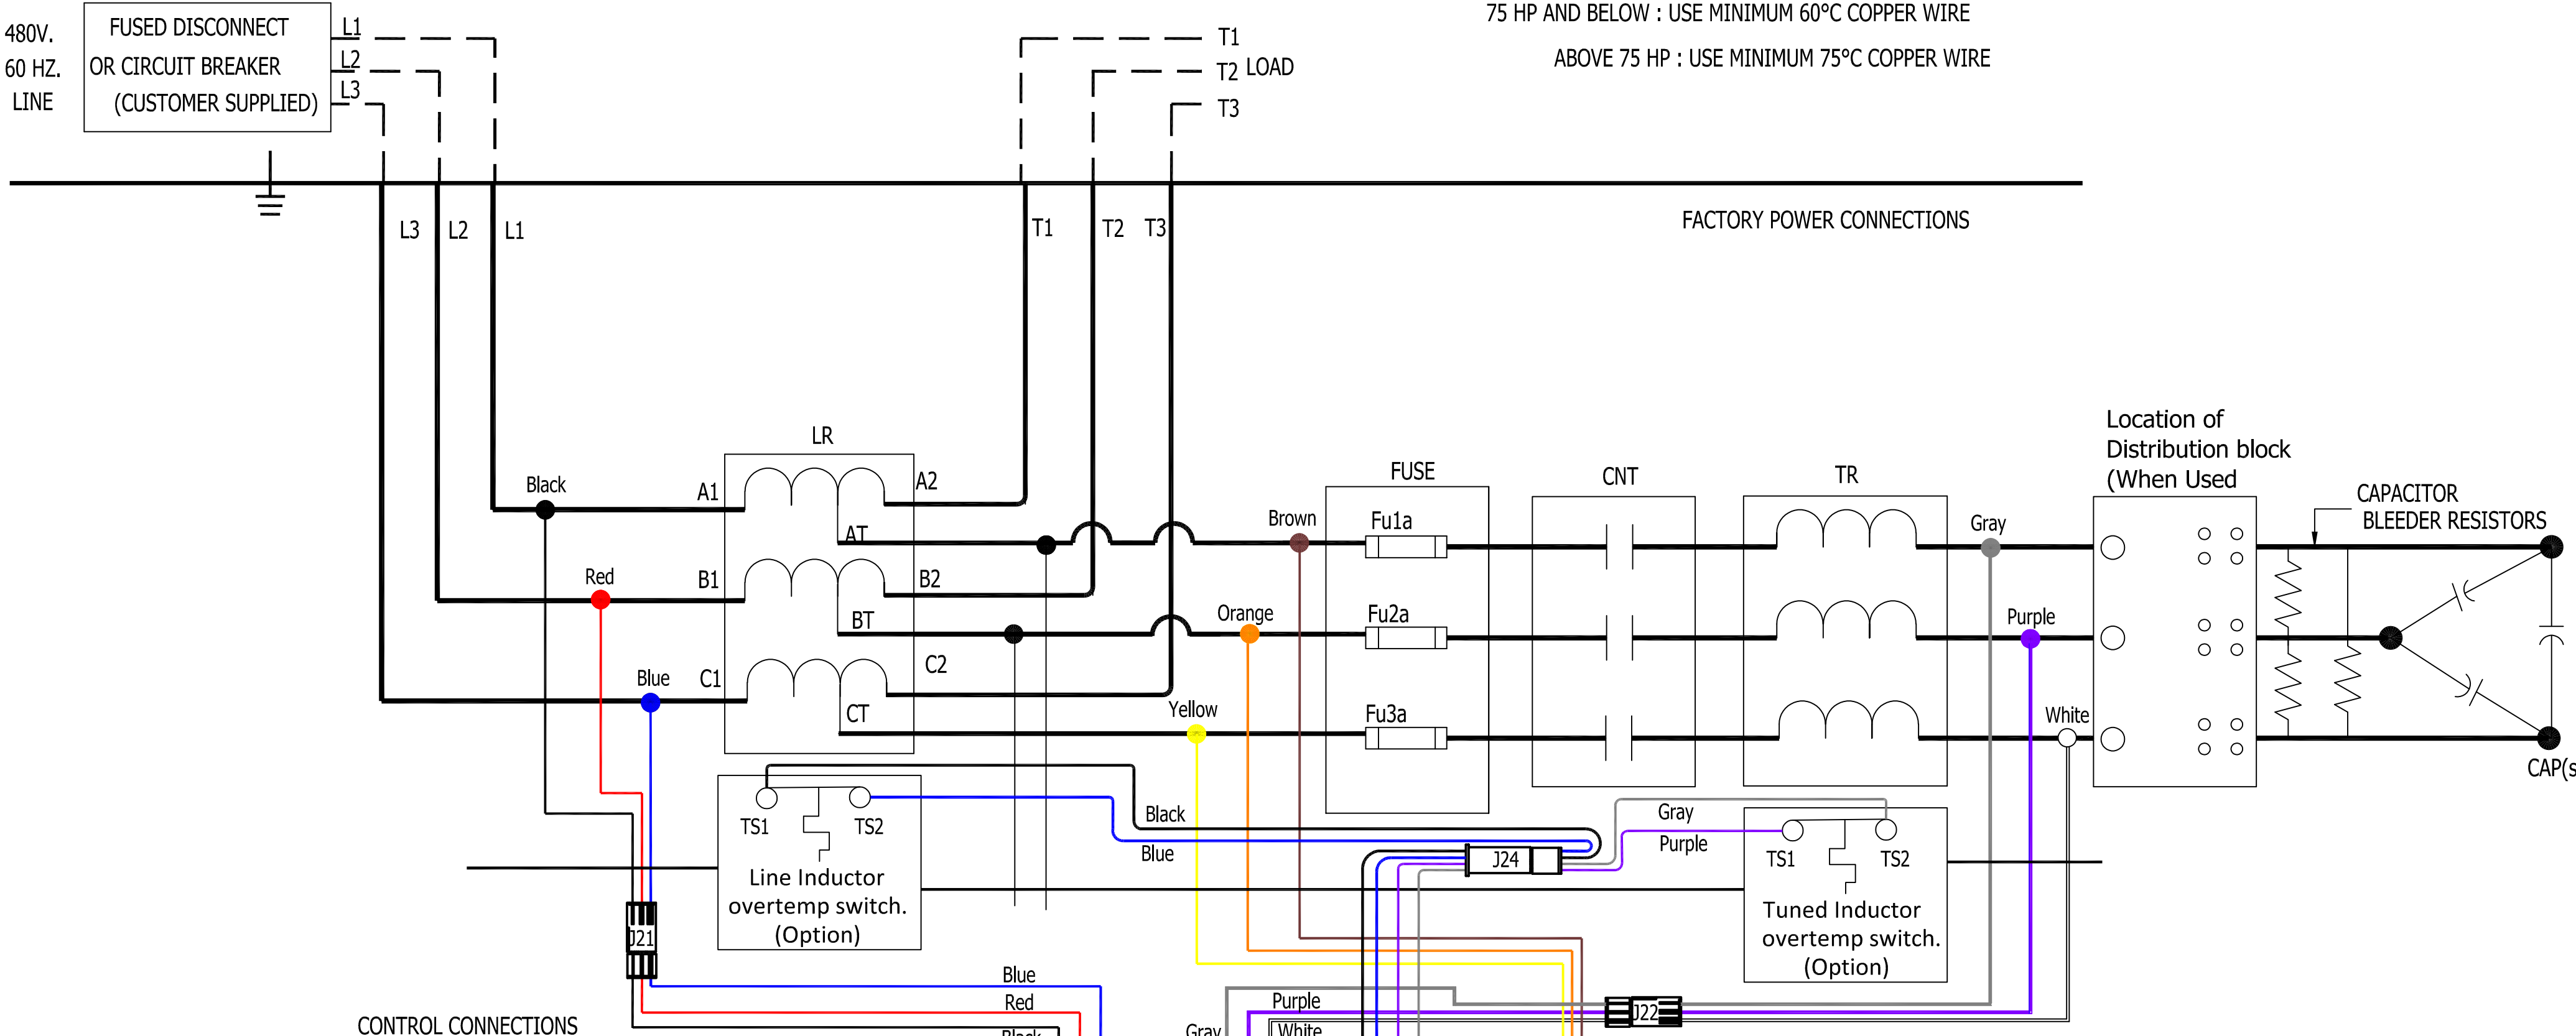

CONTROL CONNECTIONS

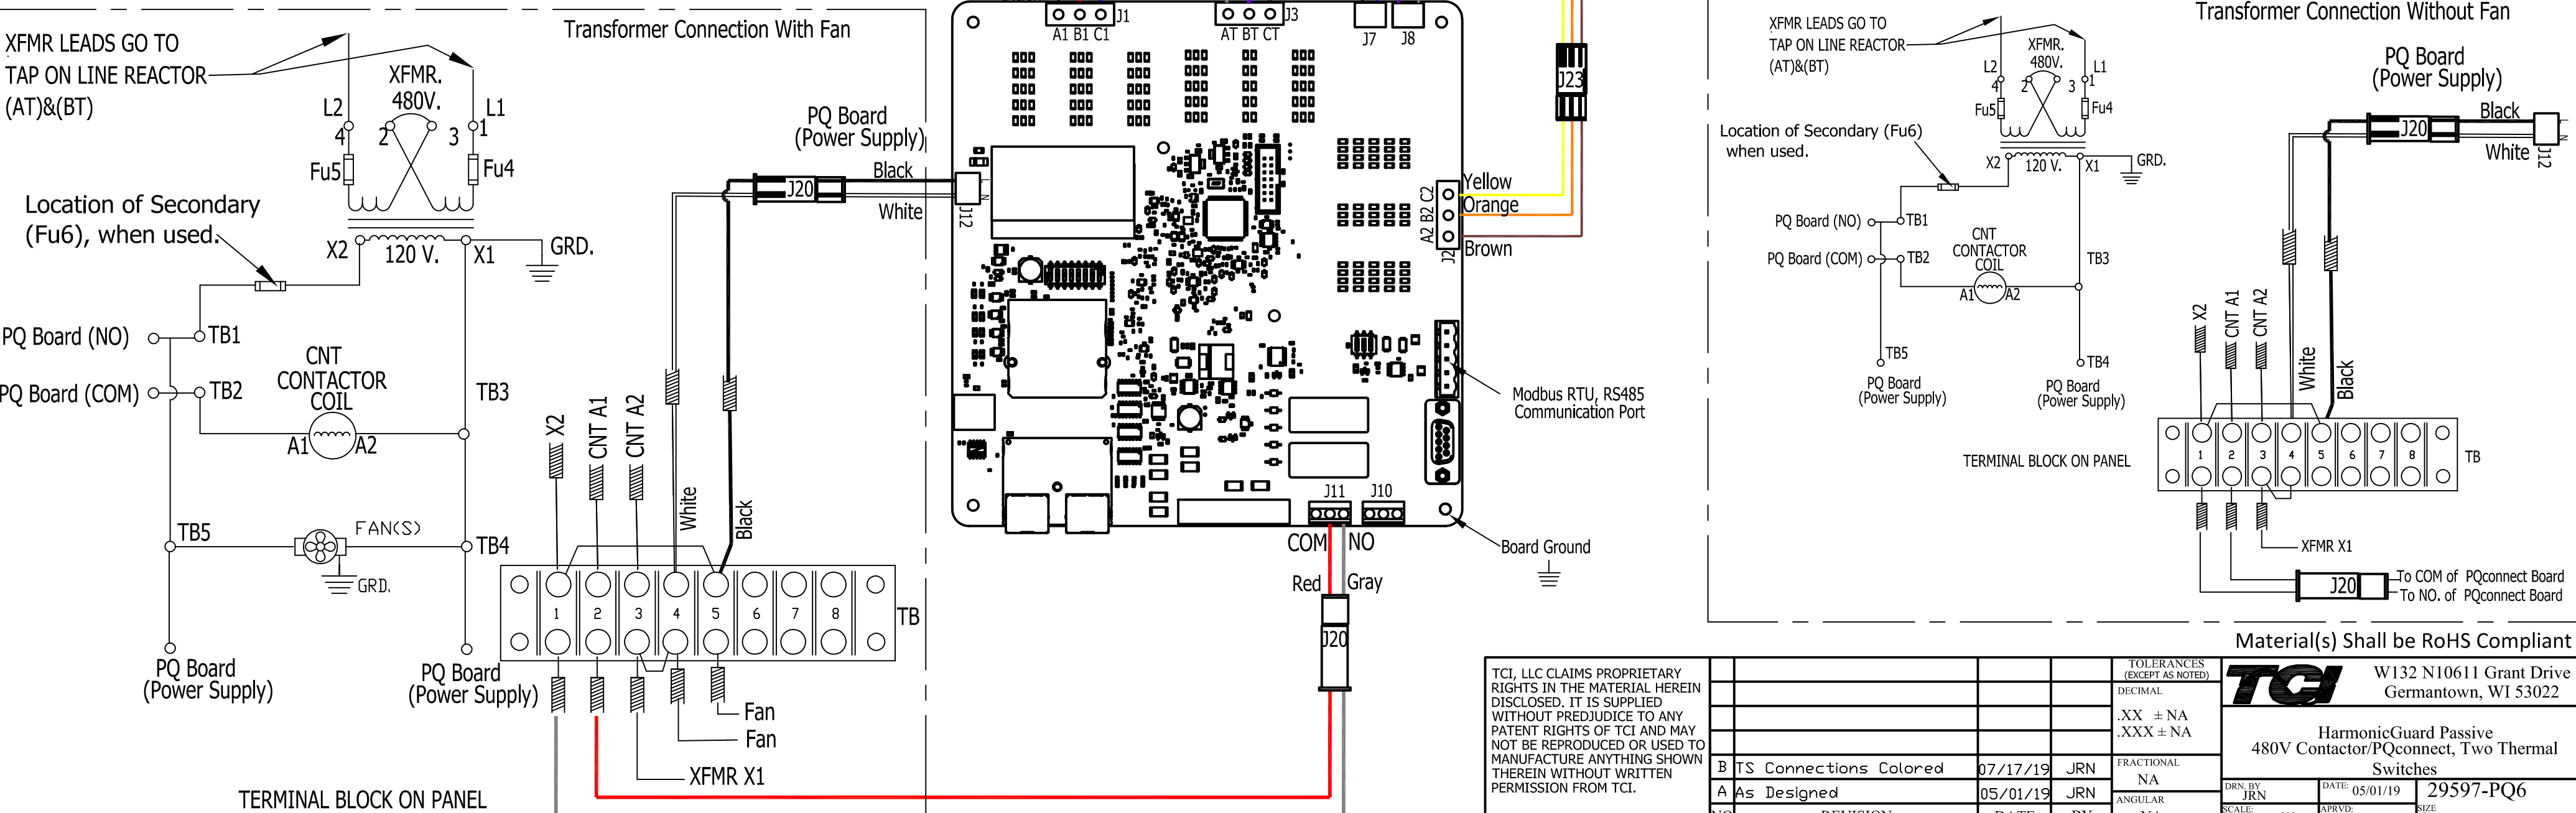

|   |                        |          |     |  |  |   |             |
|---|------------------------|----------|-----|--|--|---|-------------|
| TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREDJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI. |                        |          |     | TOLERANCES (EXCEPT AS NOTED)<br>DECIMAL<br>.XX ± NA<br>.XXX ± NA |  | W132 N10611 Grant Drive<br>Germantown, WI 53022 |             |
| B   | TS Connections Colored | 07/17/19 | JRN | FRACTIONAL<br>NA   | HarmonicGuard Passive<br>480V Contactor/PQconnect, Two Thermal<br>Switches |   |             |
| A   | As Designed            | 05/01/19 | JRN | ANGULAR<br>NA  | DRN: JRN   | DATE: 05/01/19                                  | 29597-PQ6   |
| NO  | REVISION               | DATE     | BY  | SCALE: NA  | APRVD: C   | SIZE  | SHT. 1 OF 1 |

Material(s) Shall be RoHS Compliant