
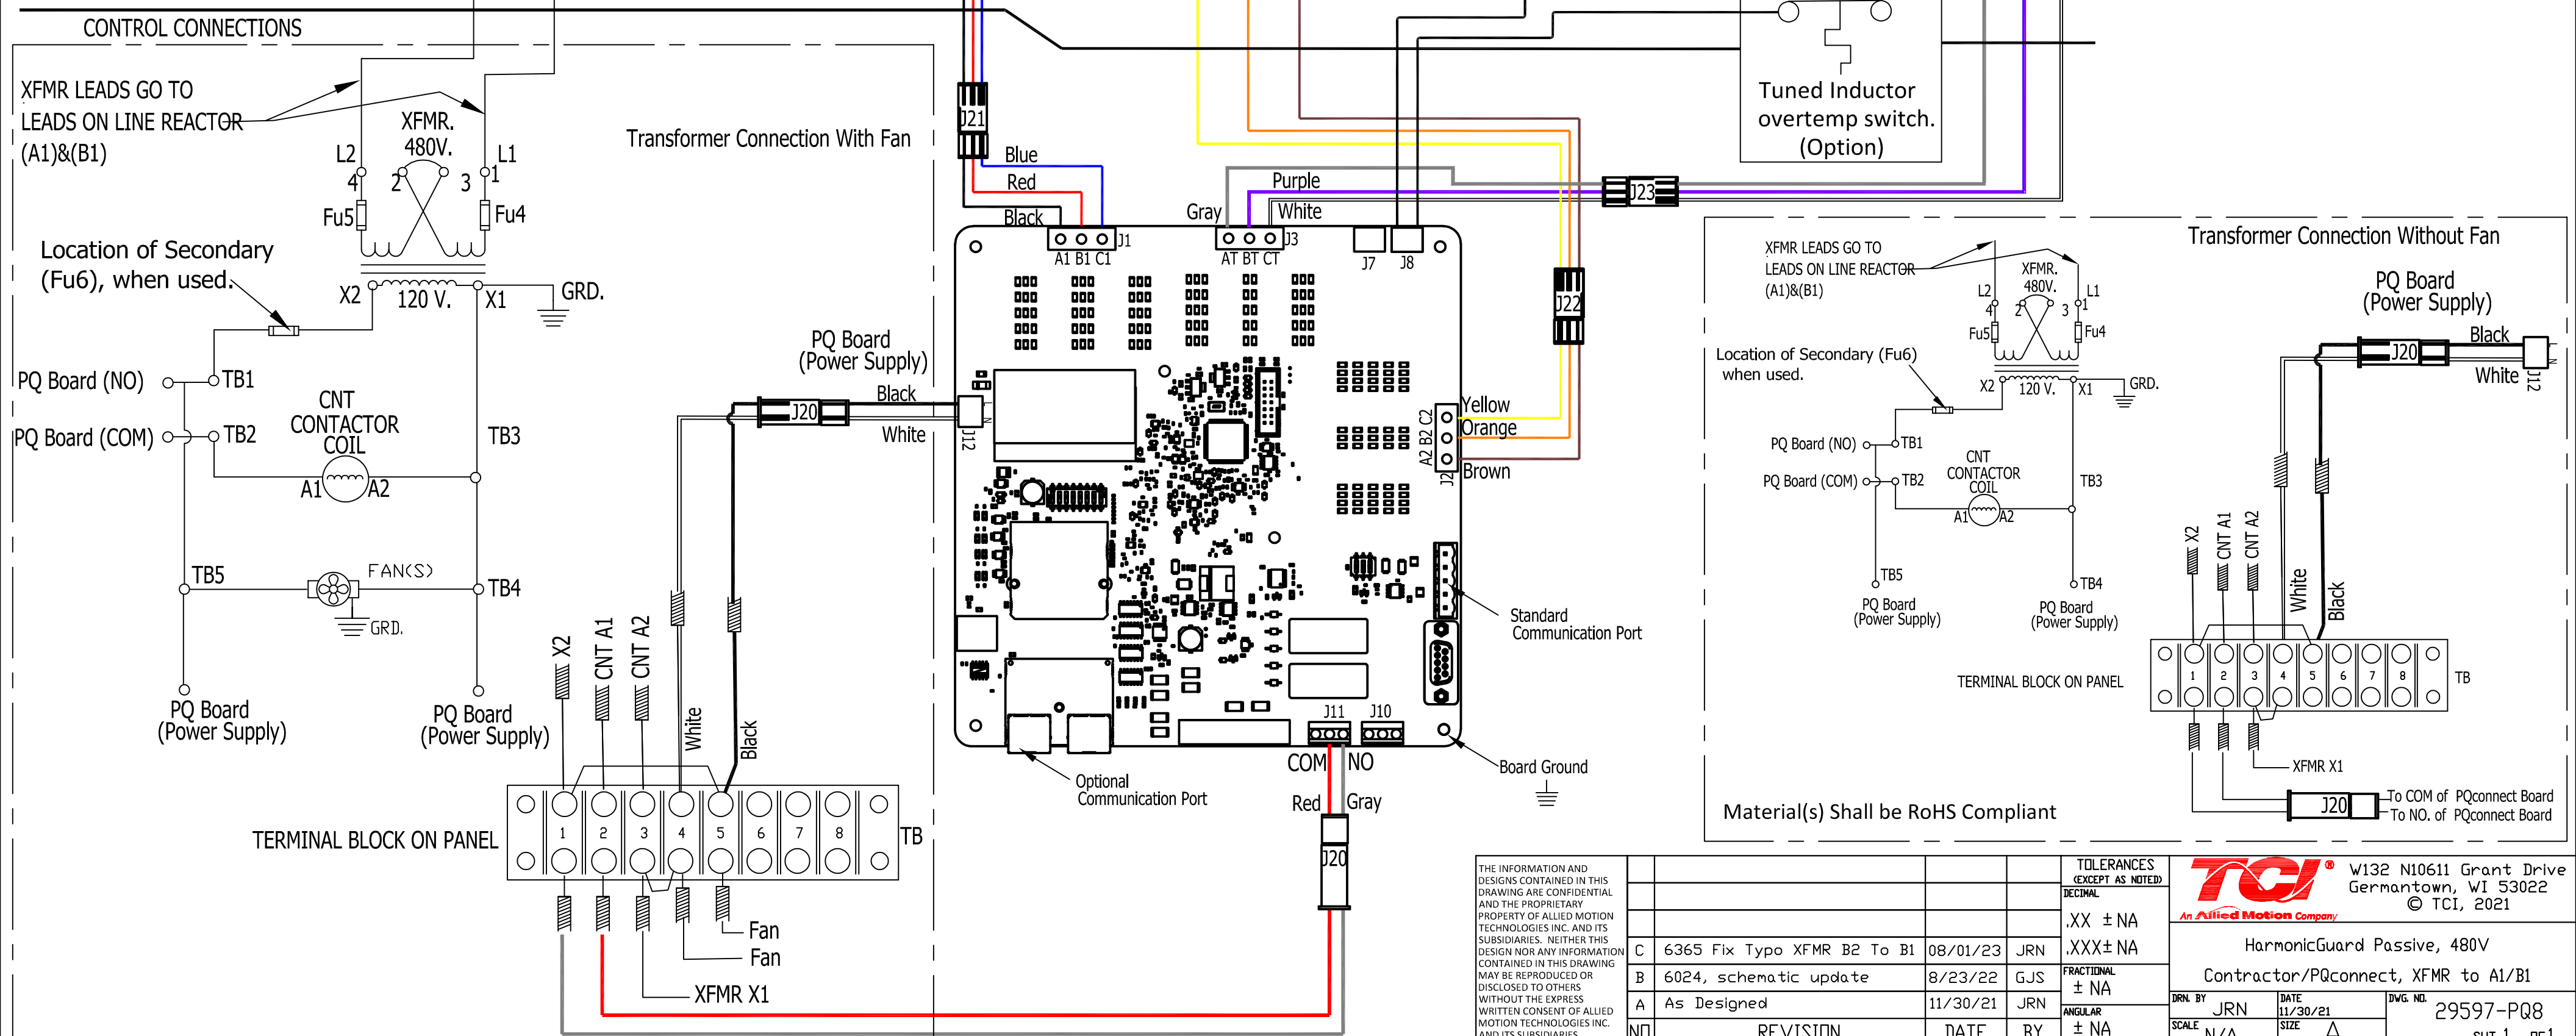


CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

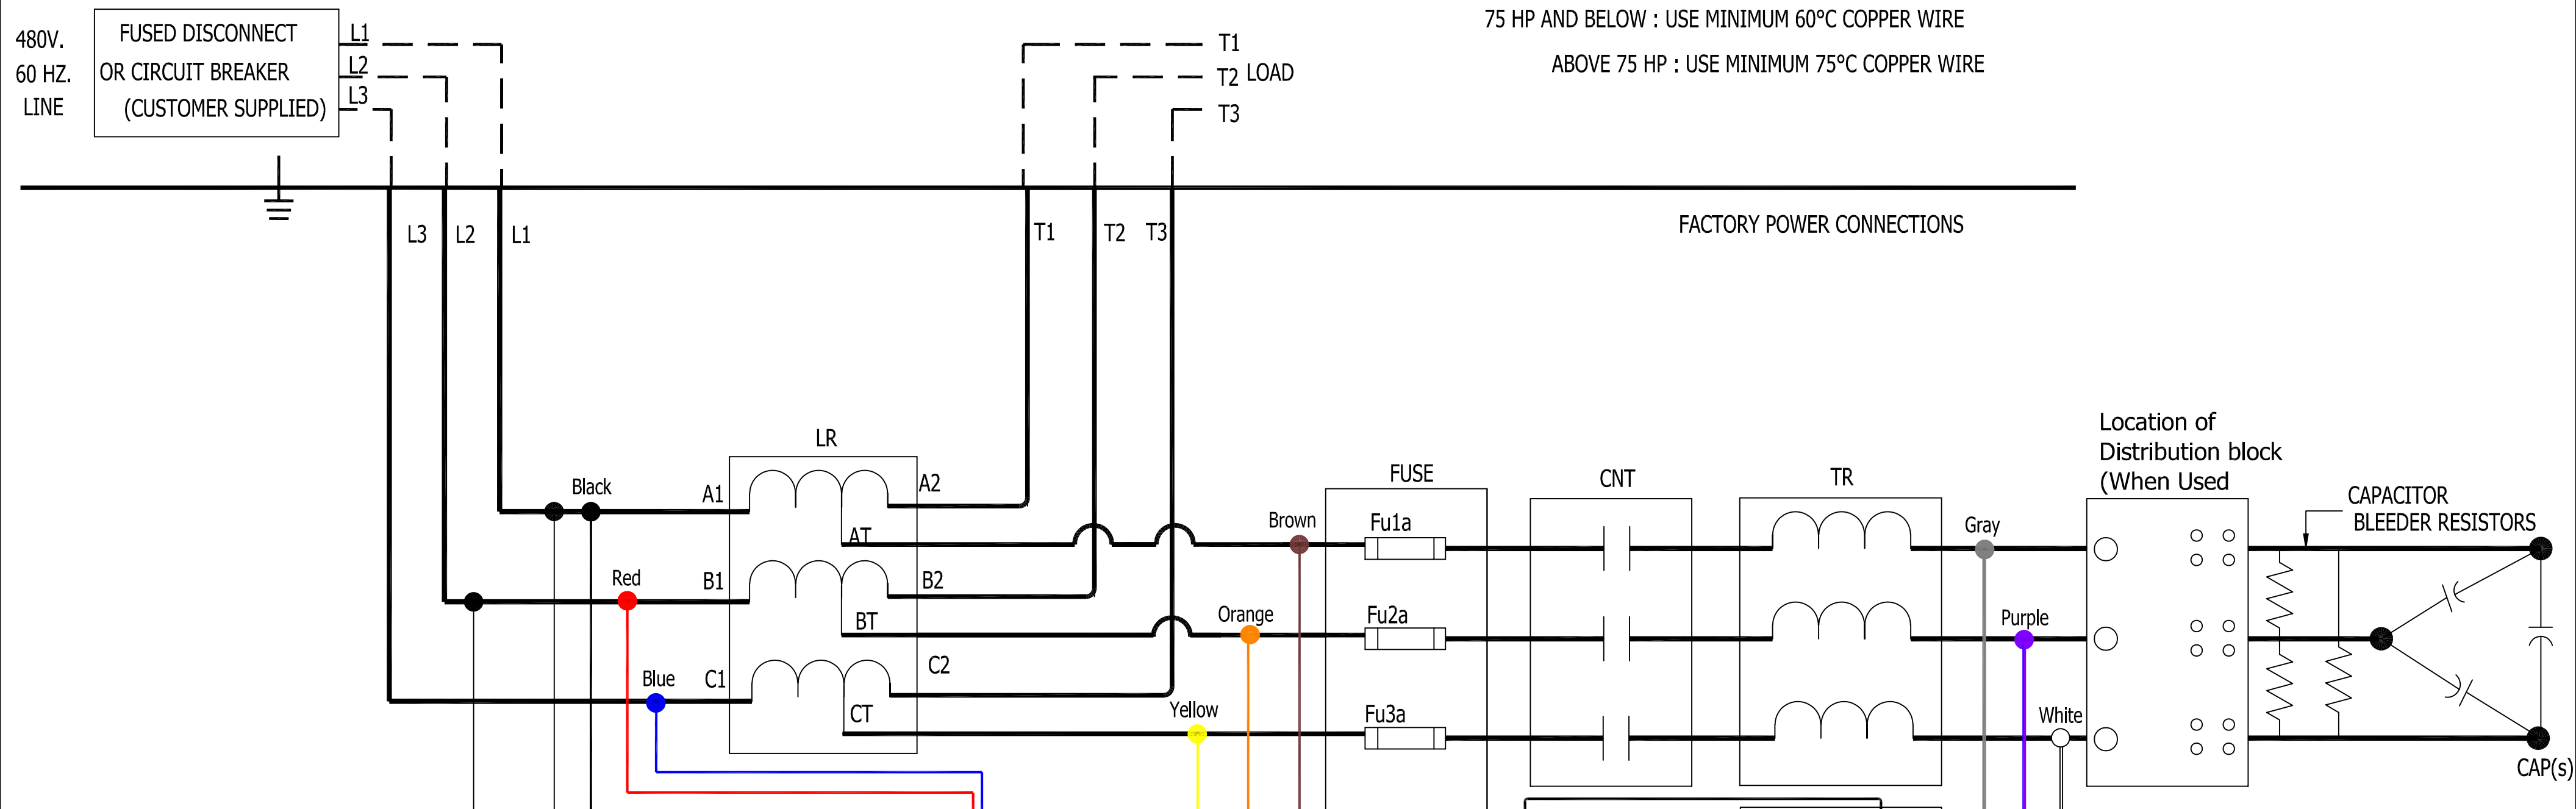

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED) DECIMAL
C	6365 Fix Typo XFMR B2 To B1	08/01/23	JRN	.XX ± NA .XXX ± NA
B	6024, schematic update	8/23/22	GJS	FRACTIONAL ± NA
A	As Designed	11/30/21	JRN	ANGULAR ± NA
NO				

TCI W132 N10611 Grant Drive
 Germantown, WI 53022
 © TCI, 2021

HarmonicGuard Passive, 480V
 Contractor/PQconnect, XFMR to A1/B1

DRN. BY JRN DATE 11/30/21 DWG. NO. 29597-PQ8
 SCALE N/A SIZE A SHT. 1 OF 1