

480V.
60 HZ.
LINE

FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

L1
L2
L3

CUSTOMER CONNECTIONS


T1
T2
T3

LOAD

CUSTOMER CONNECTIONS


75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

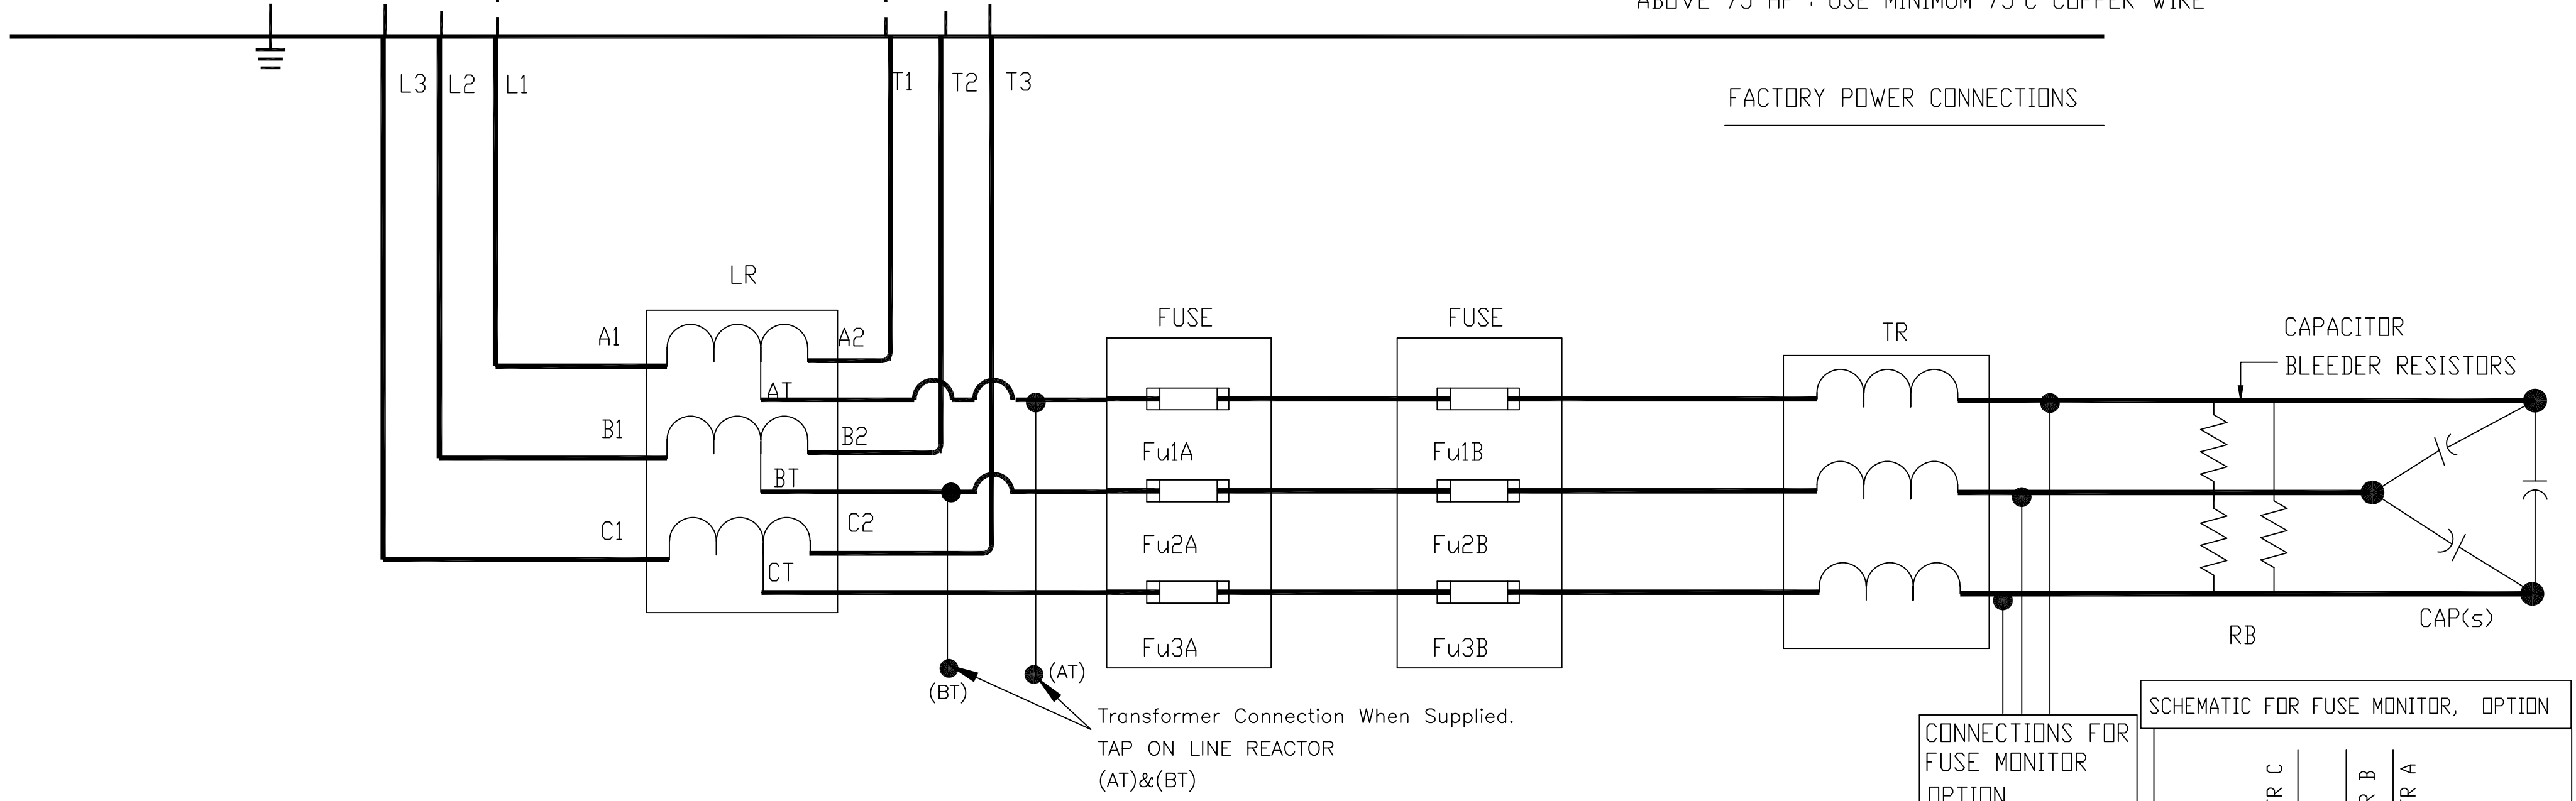


CONNECTIONS FOR
FUSE MONITOR
OPTION

SCHEMATIC FOR FUSE MONITOR, OPTION

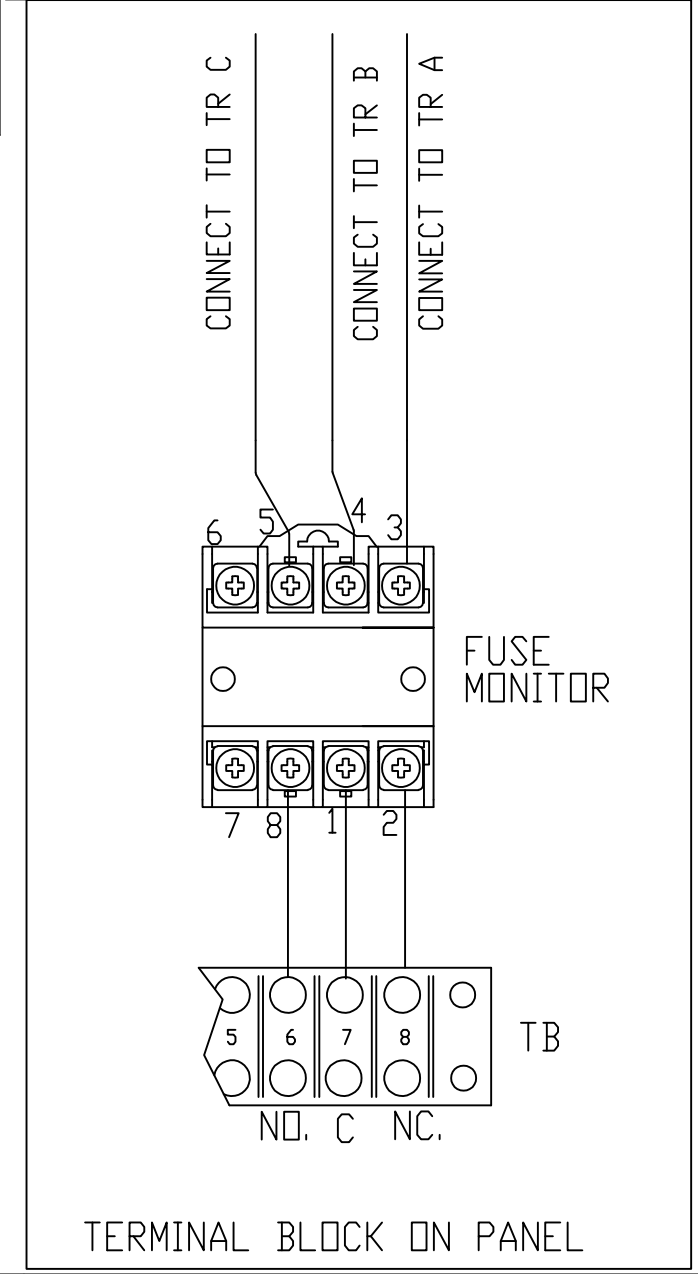

CONTROL CONNECTIONS WITH IF FAN(S) SUPPLIED

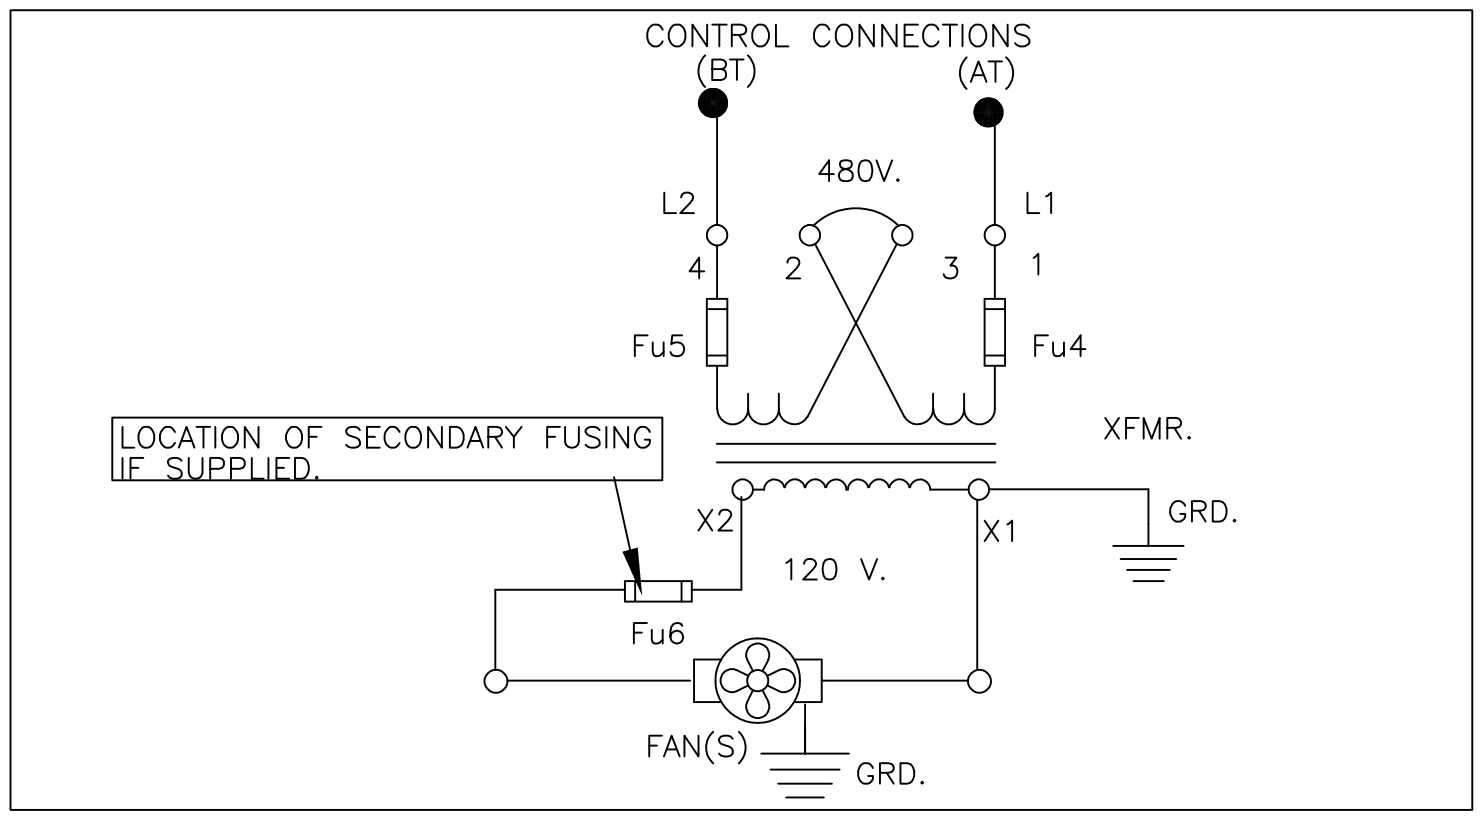

TCL, LLC CLAIMS
PROPRIETARY RIGHTS IN
THE MATERIAL HEREIN
DISCLOSED. IT IS
SUPPLIED WITHOUT
PREJUDICE TO ANY
PATENT RIGHTS OF TCL
AND MAY NOT BE
REPRODUCED OR USED
TO MANUFACTURE
ANYTHING SHOWN
THEREIN WITHOUT
WRITTEN PERMISSION
FROM TCL.

NO	REVISION	DATE	BY

TOLERANCES
(EXCEPT AS NOTED)
DECIMAL
.XX ± NA
.XXX ± NA
FRACTIONAL
± NA
ANGULAR
± NA

TCL W132 N10611 GRANT DRIVE
GERMANTOWN, WI 53022

HGL PASSIVE
40HP, 50HP, 480V SCHEMATIC
Standard VERSION

DRN. BY DSW DATE 3/31/17 DWG. NO. 30586-S
SCALE NONE SIZE C SHT. 1 OF 1