

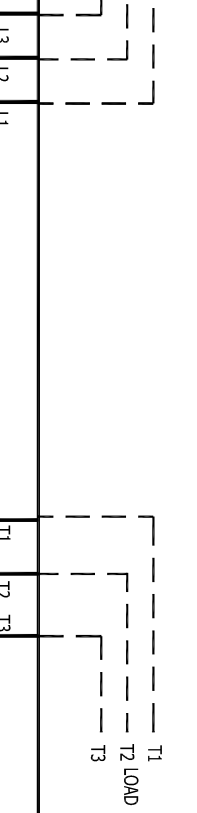
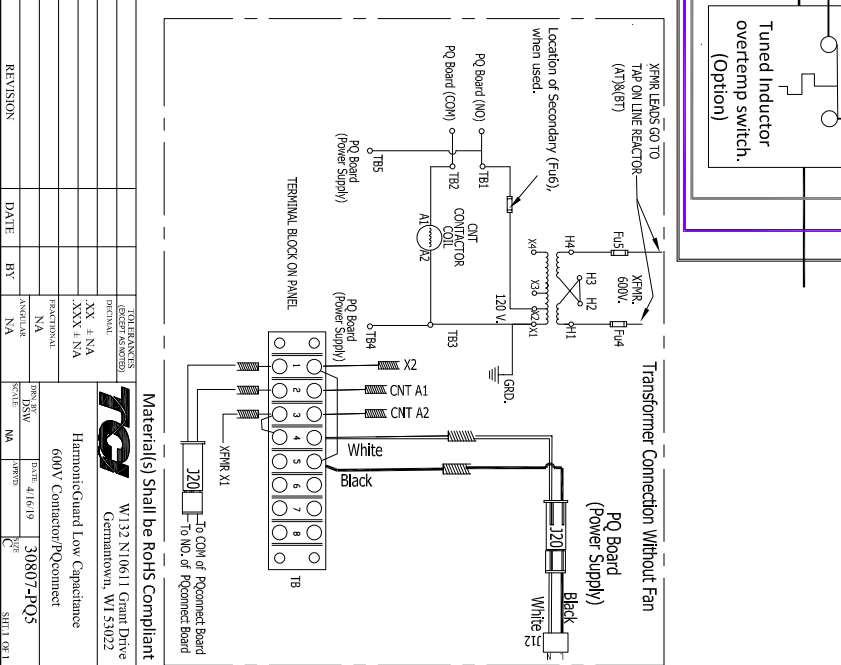
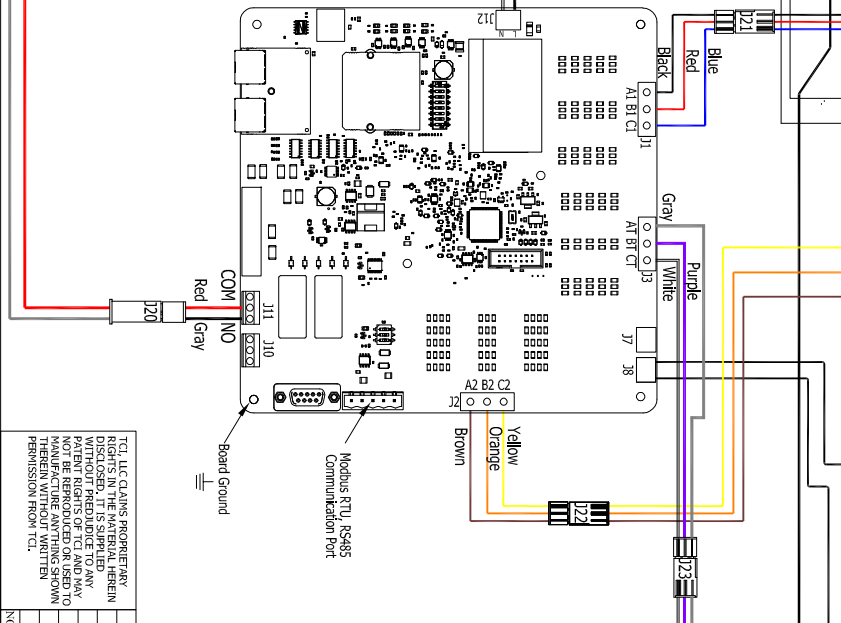
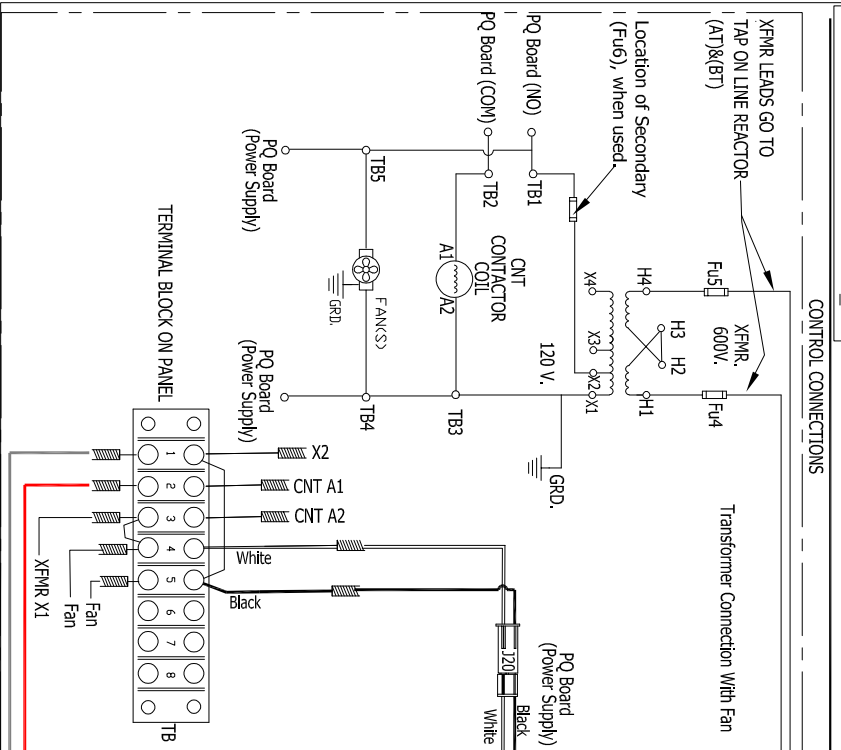
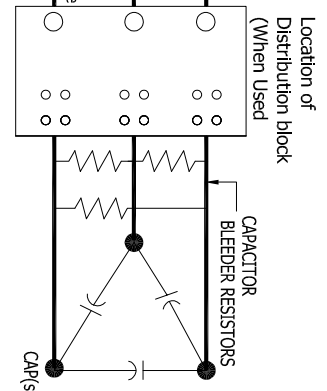


600V,  
60 HZ.  
OR CIRCUIT BREAKER  
(CUSTOMER SUPPLIED)

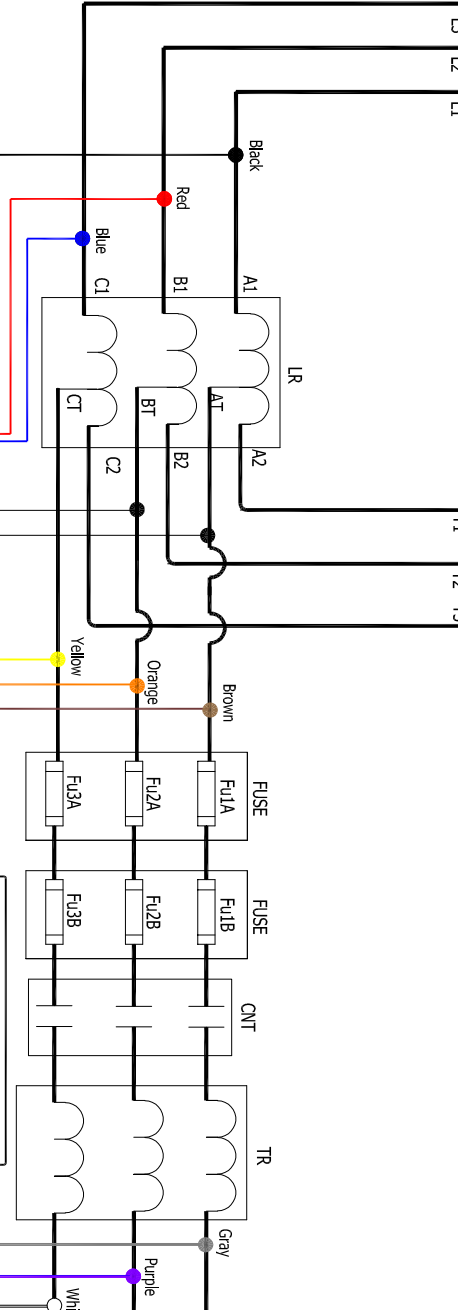

CUSTOMER CONNECTIONS  
75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

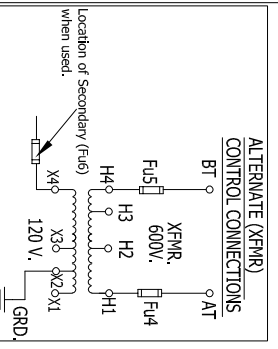

TCL LLC GAINS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED UNDER LICENSE TO THE CUSTOMER. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR USED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION FROM TCL.

NO.	REVISION	DATE	BY	APPROVED	SCALE

Material(s) Shall be RoHS Compliant  
 W132 N10611 Grant Drive  
 Germantown, WI 53022  
 30807-POS  
 DATE: 11/16/19  
 SCALE: 1:1