
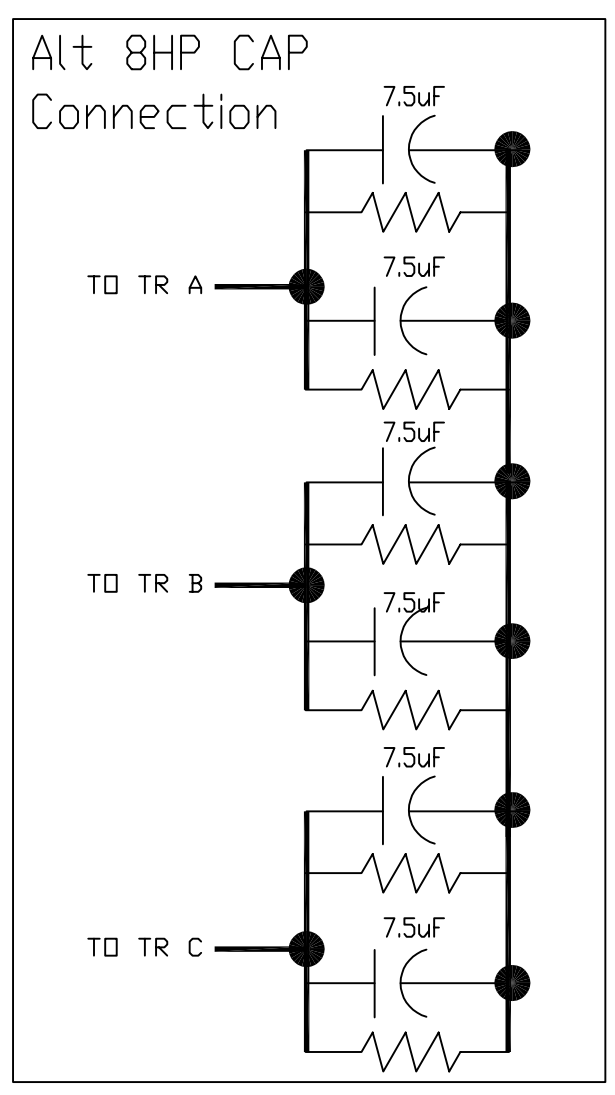
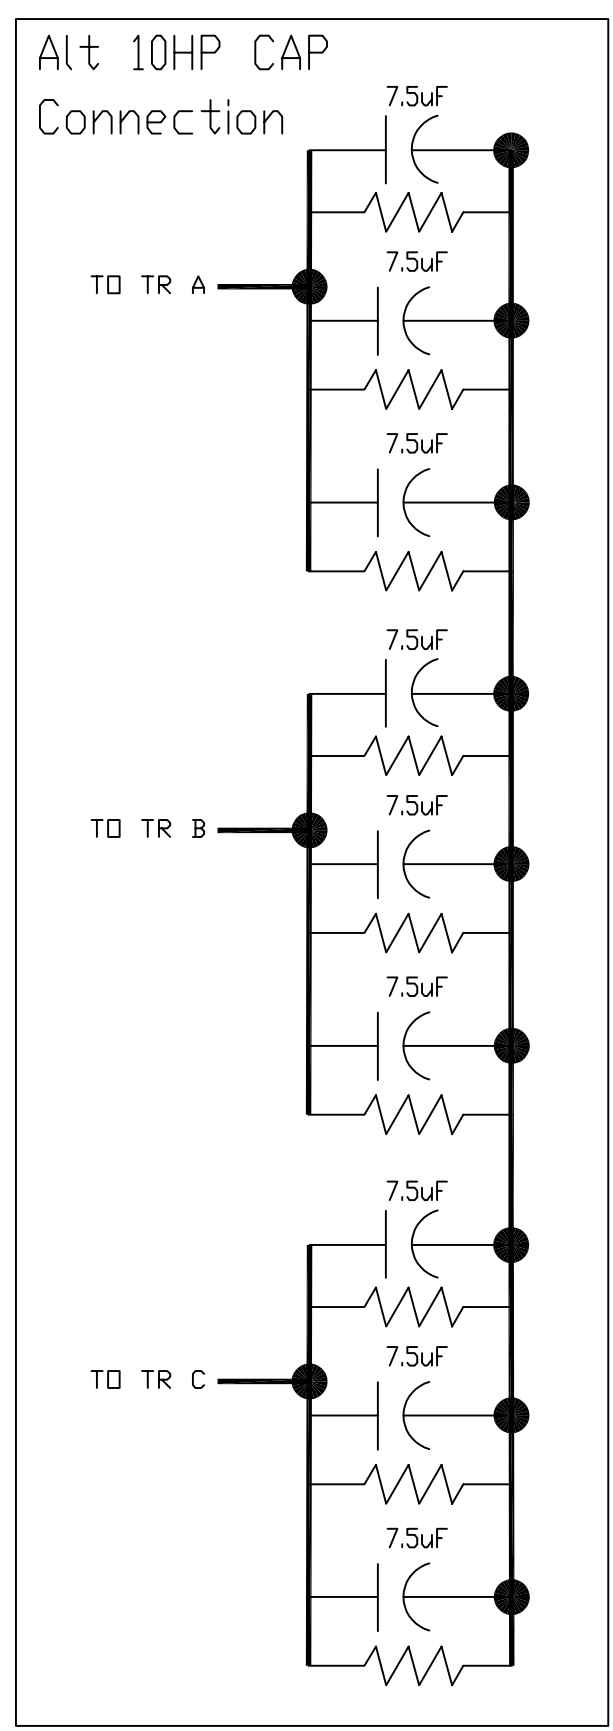
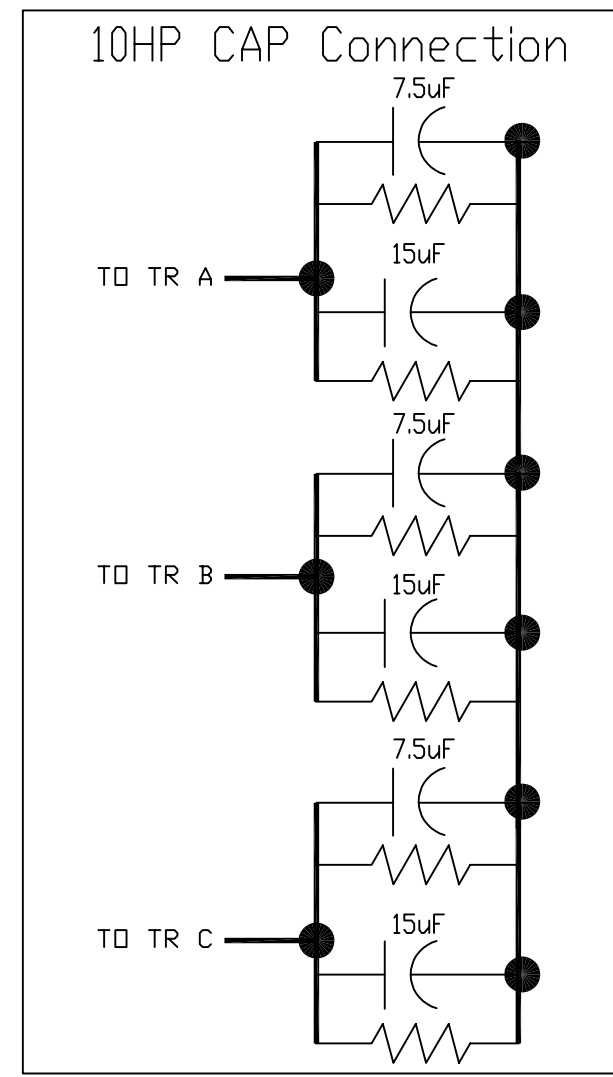
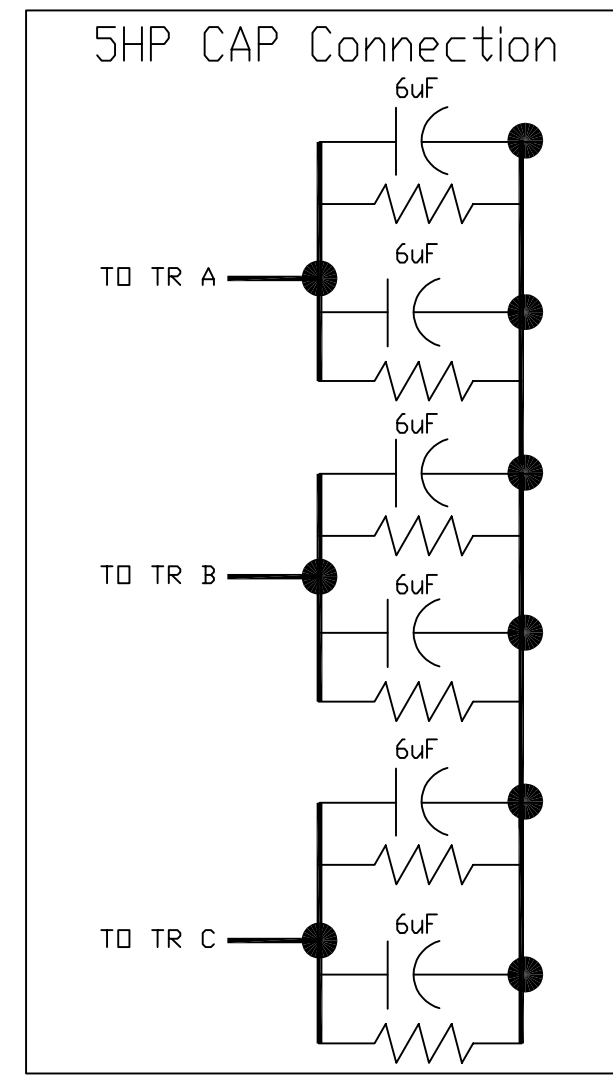
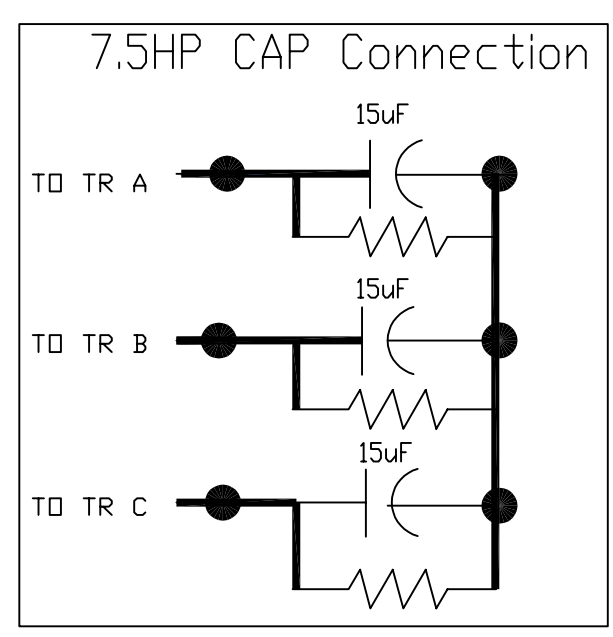


CUSTOMER CONNECTIONS
 75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

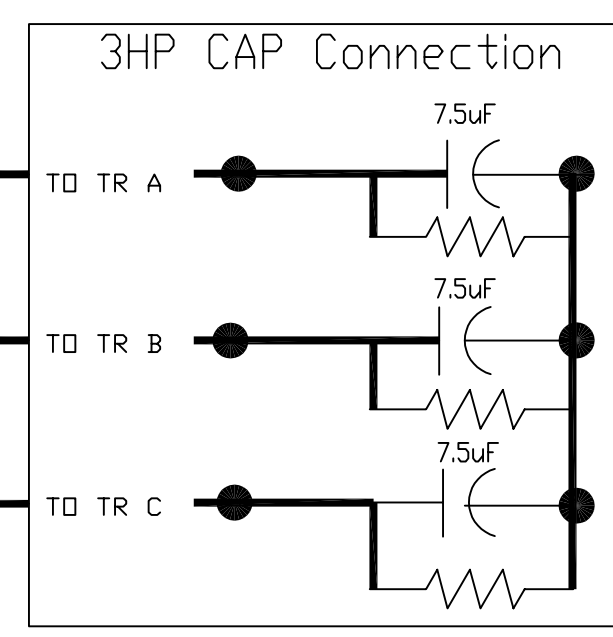

Alternate Cap Configurations As Supply Allows

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

				TOLERANCES (EXCEPT AS NOTED) DECIMAL
				.XX ± NA
				.XXX ± NA
6305	Alt Configuraitons	06/12/23	JRN	FRACTIONAL ± NA
A	As Designed	6/26/19	DSW	ANGULAR ± NA
NO	REVISION	DATE	BY	

TCI W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022

HARMONICGUARD PASSIVE
 600V SCHEMATIC
 3HP TO 10HP

DRN. BY DSW DATE 6/26/19 DWG. NO. 31663
 SCALE NONE SIZE C

SHT. 1 of 1