
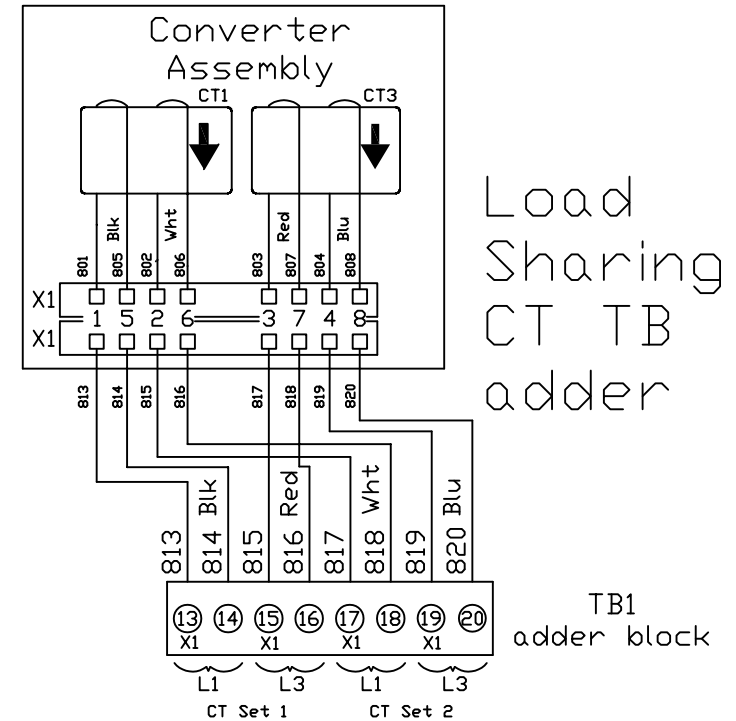


CT Disconnect Detail

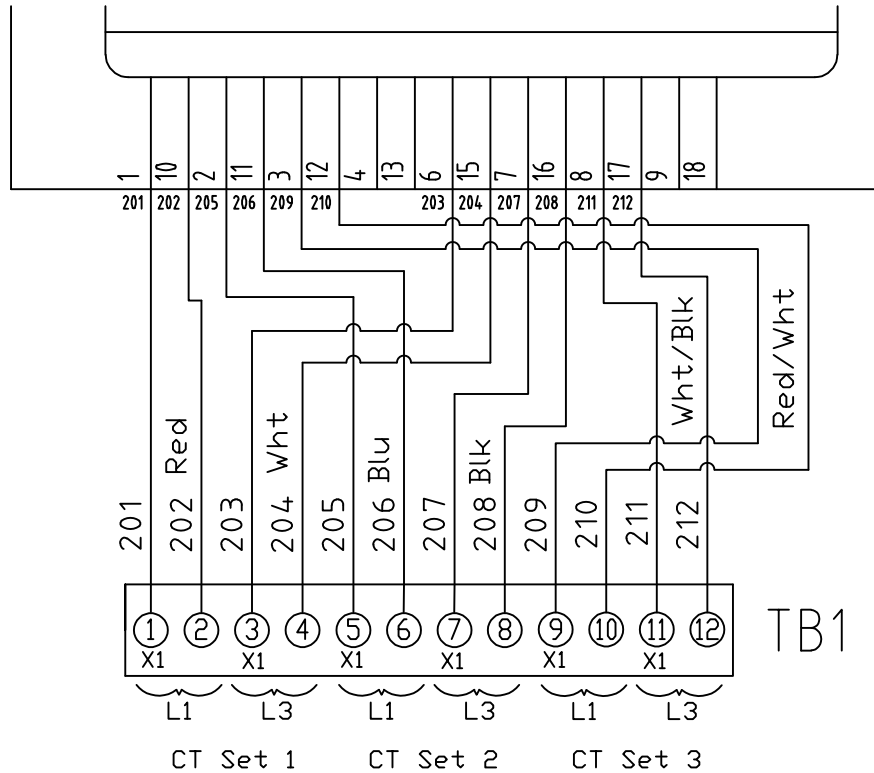

Notes:

- 1) This is the wiring for the additional 8 TB's added for Load Sharing CT Customer connections and additional internal wire routings through converter CT's

TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ±.01 .XXX±.005 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.						DRAWN BY JSG		W132 N10611 Grant Drive Germantown, WI 53022 ©Allient Inc. 2024		
							DATE 3/26/25				
								Schematic, Gen II 200/250A Active Filter, Type 12			
					See Page 1 for Rev.						
		NO	ECO	REVISION	DATE	BY	SCALE None	DWG. NO. 33209	SHT. ? OF ?		