



Enclosure
Enviroment
Control Circuit

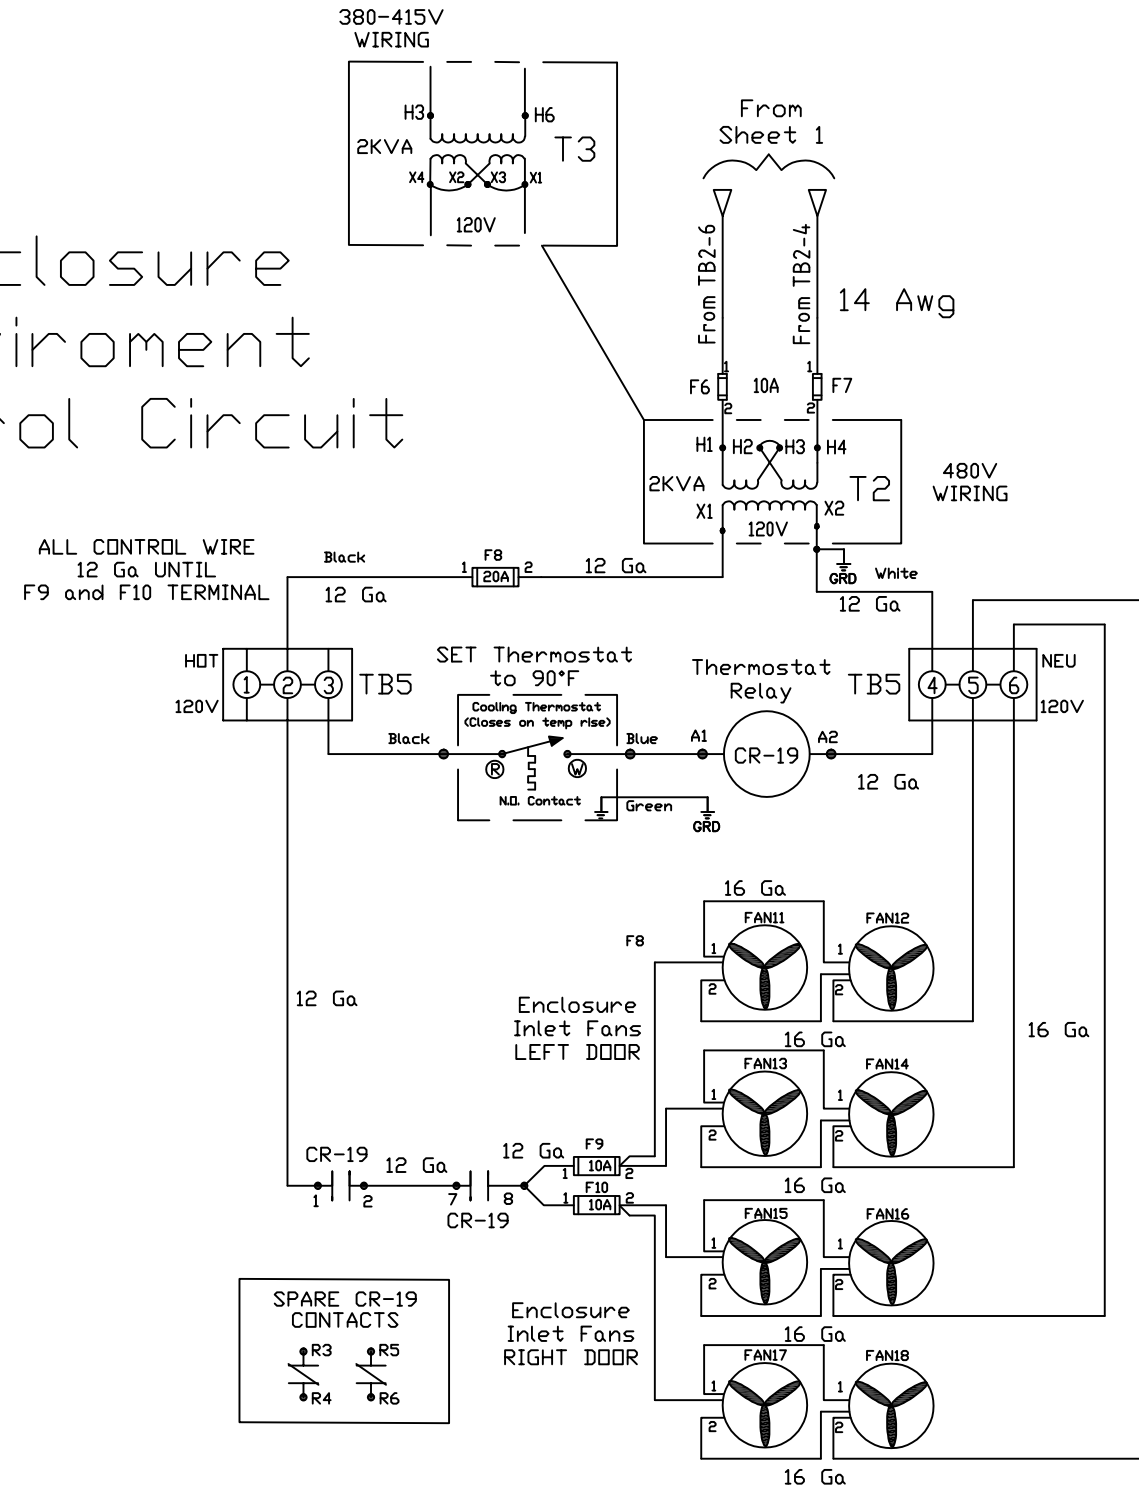

Notes:

1. Refer to schematic #28283-1 on units with network gateways.
2. OT1 and OT2 are located in the exhaust area of the inductor tunnel on their respective side.
3. 120Vac Input Power for the Display Interface PCB can be tapped off the Control Transformer 120Vac Output secondary fuse or provided externally. For external wiring, follow all NEC guidelines.
4. Refer to new converter schematic #33192


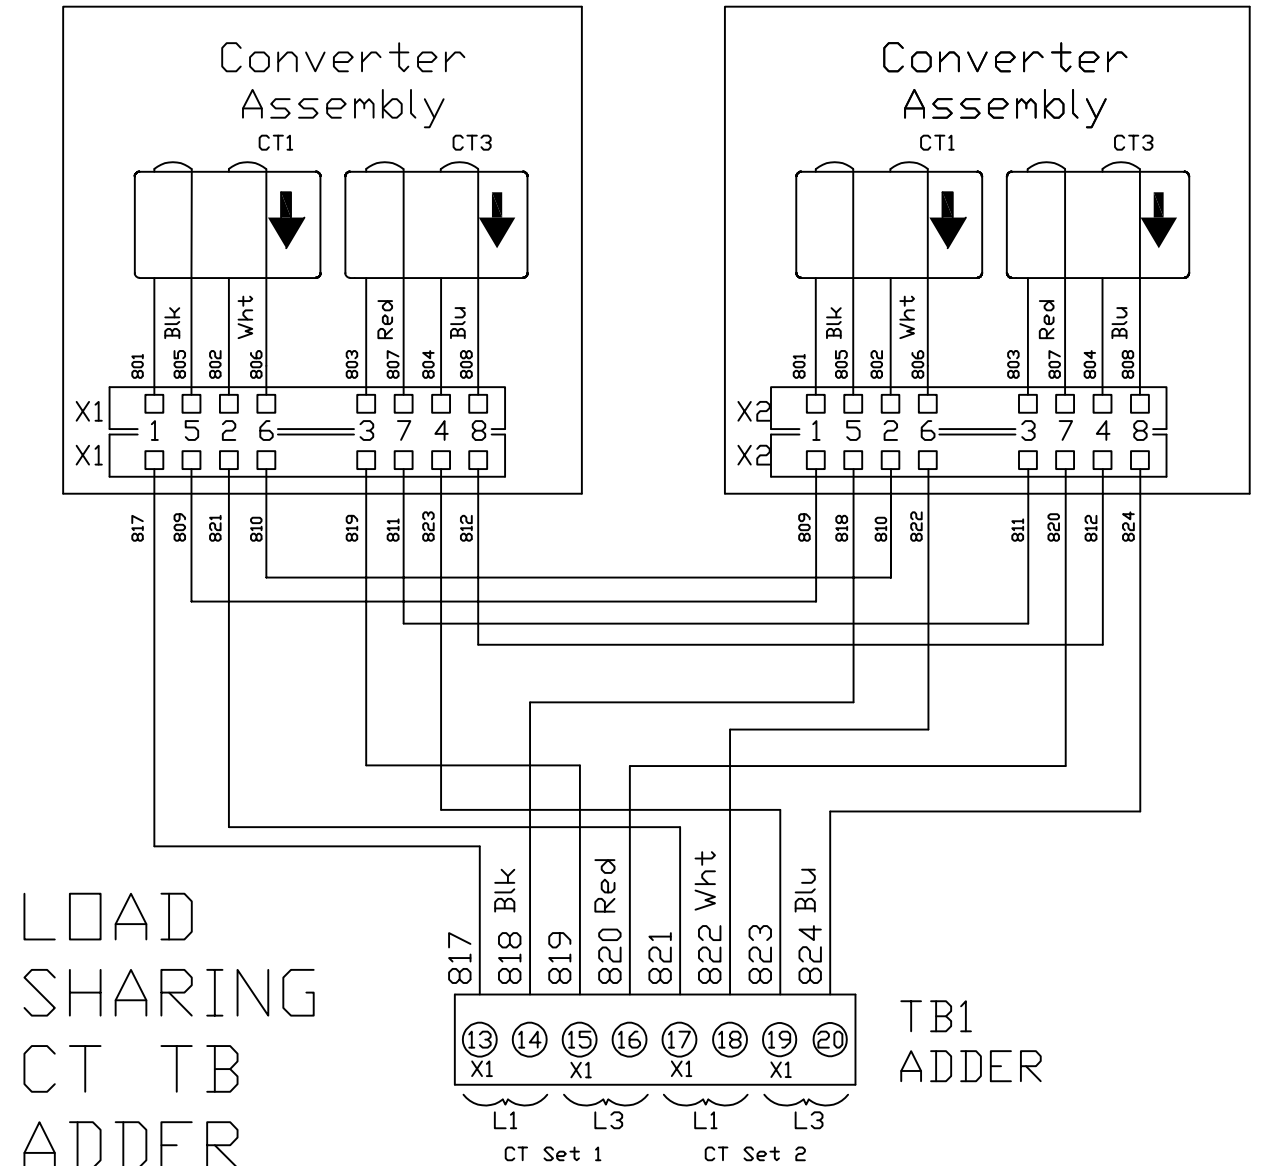


Note:

1. This is the wiring for the additional 8 TB's added for Load Sharing CT Customer connections and additional internal wire routings through converter CT's

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.				DRAWN BY		 W132 N10611 Grant Drive Germantown, WI 53022 ©Allient Inc. 2024			
DECIMAL						MJS					
.XX ±.01						DATE		3/24/25		Schematic, Gen II 400/500A Active Filter, Type 12	
.XXX±.005											
FRACTIONAL											
± 1/32											
ANGULAR											
± 1/2°				See page 1 for revision							
		NO ECO		REVISION		DATE		BY			
								SCALE None			
								DWG. NO. 33210			
								SHT. 2 OF 3			

CT Wiring Detail

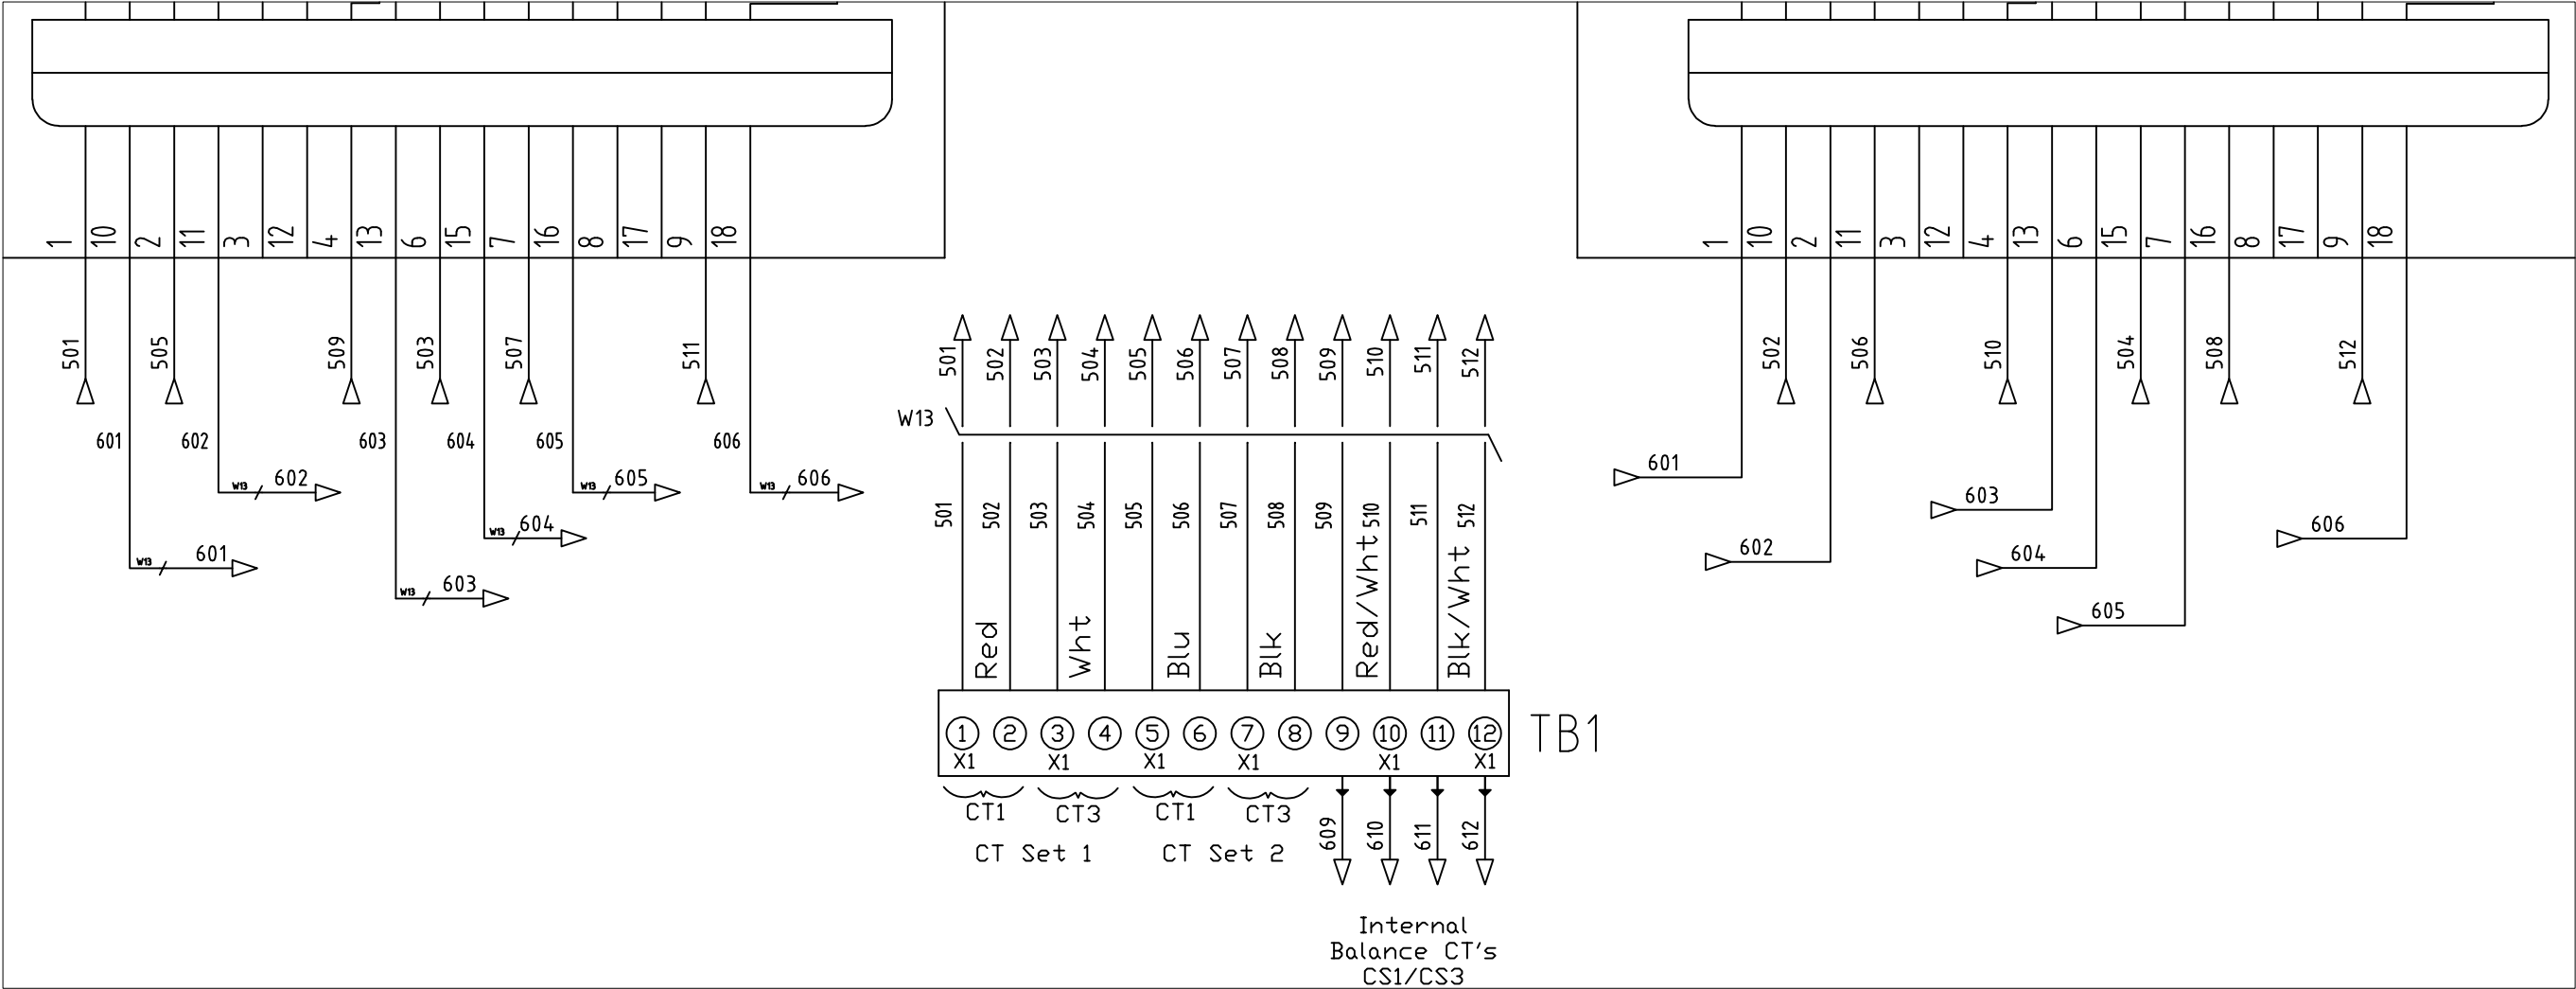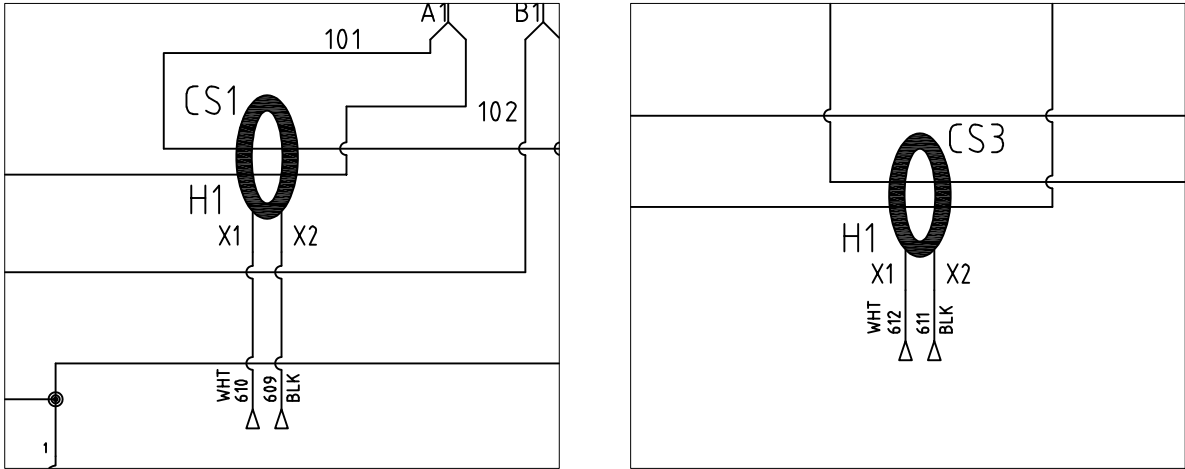

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.						DRAWN BY				W132 N10611 Grant Drive Germantown, WI 53022 ©Allient Inc. 2024	
DECIMAL								MJS					
.XX ±.01								DATE		3/24/25			
.XXX±.005													
FRACTIONAL		See page 1 for revision								Schematic, Gen II 400/500A Active Filter, Type 12			
± 1/32													
ANGULAR													
± 1/2°													
		NO	ECD	REVISION		DATE		BY	SCALE	None	DWG. NO.	33210	SHT. 3 OF 3